

D77A-DI8, D77A-DI16 24V DC Sink/Source Input Installation Leaflet

Installation of the D77A-DIx

The D77A-DIx is designed to be used in industrial applications and installed in accordance with this document. The intended use of the D77A-DIx is for use in clean, dry environments.

Mount the D77A-DIx to the DIN Rail




To mount the D77A-DIx to a DIN rail the following procedure must be performed.

- Rotate the orange locking cams to unlock the customer wiring terminal from the D77A-DIx module.
- Remove the terminal from the D77A-DIx.
- Using a screwdriver or fingernail, gently pull out the locking tab located at the right side center of the D77A-DIx module.
- Insert the D77A-DIx module on to the DIN rail.
- Depress the locking tab to secure the D77A-DIx to the DIN rail.
- Reassemble the customer wiring terminal to the D77A-DIx.

Install the Field Wiring on the D77A-DIx

The customer wiring terminal is used to connect the field wiring to the D77A-DIx module. Each terminal accepts two wires of the following size.


Wire Type	Wire Size	Terminal Torque
Solid Cu-90°C	#14 - # 22 AWG	4.5 in-lbs.
Stranded Cu-90°C	#16 - # 22 AWG	4.5 in-lbs.

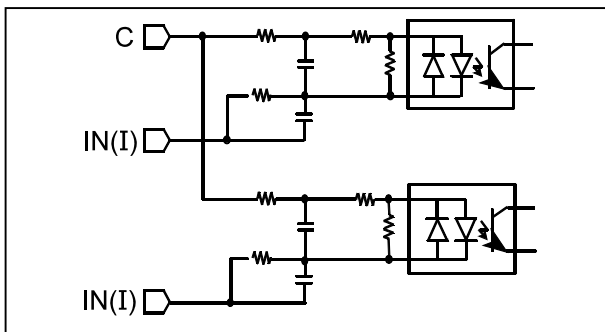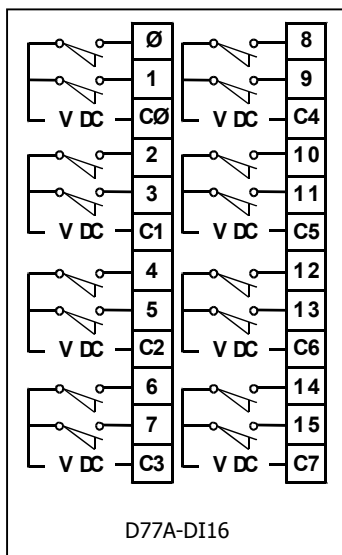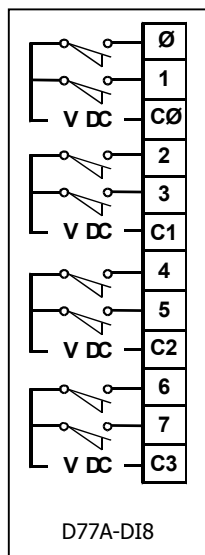

Set the Group ID of the D77A-DIx

The Group ID is set using the rotary switch located at the top face of the D77A-DIx module.

The example to the right has the group ID switch set to 3 on the left and 11 on the right.



Setup and Configuration of the D77A-DIx

The IT, D77A-DI8, D77A-DI16 requires no extra setup or configuration for normal operation than setting the Group ID. There are extended parameters that can be set to control the input debounce for each input point. For more information on the parameters and how to modify them refer to the user manual **MN05002001E**.

Input Specifications of the D77A-DIx

Nominal Voltage	24V DC
Operating Voltage	18 – 30V DC
Number of Inputs	8 (D77A-DI8) 16 (D77A-DI16)
Points Per Common	2
Signal Delay	5 mS (programmable 1 to 250 mS)
Off State Voltage	< 6V DC
On State Voltage	> 18V DC
Nominal Input Current	5 mA
Isolation	1500V
Module Current Draw	35 mA (D77A-DI8) 49 mA (D77A-DI16)

Environmental Ratings of the D77A-DIx

Transportation and Storage	Temperature	-50°C to 80°C [-58°F to 176°F]
	Humidity	5 – 95% non-condensing
Operating	Temperature	-25°C to 55°C [-13°F to 131°F]
	Humidity	5 – 95% non-condensing
	Altitude	Above 2000 meters [6600 feet] consult factory
	Shock IEC 68-2-27	15G any direction for 11 milliseconds
	Vibration IEC 68-2-6	5 – 150 Hz, 5G, 0.7 mm maximum peak-to-peak

Approvals/Certifications of the D77A-DIx

Electrical/EMC	
•ESD Immunity (IEC61000-4-2)	+/- 8kV air, +/- 4kV contact
•Radiated Immunity (IEC61000-4-3)	10V/m 80-1000 MHz, 80% amplitude modulation @ 1kHz
•Fast Transient (IEC61000-4-4)	+/- 2kV supply and control +/- 1kV communications
•Surge (IEC61000-4-5)	+/- 1kV line-to-ground +/- 2kV line-to-line
•RF Conducted (IEC61000-4-6)	10V, 0.15 – 80MHz
•Magnetic Field (IEC61000-4-8)	30 A/m, 50Hz
Ingress Protection Code	IP20
Radiated and Conducted Emissions	EN5011 Class A
Agency Certifications	UL 508 CUL (CSA C22.2 No. 14) CE (Low Voltage Directive)


Default Output Data for the D77A-DI8

Bit Position								
Byte	7	6	5	4	3	2	1	0
0	I7	I6	I5	I4	I3	I2	I1	I0

Default Output Data for the D77A-DI16

Bit Position								
Byte	7	6	5	4	3	2	1	0
0	I7	I6	I5	I4	I3	I2	I1	I0
1	I15	I14	I13	I12	I11	I10	I9	I8

Spacing Requirements for the D77A-DIx

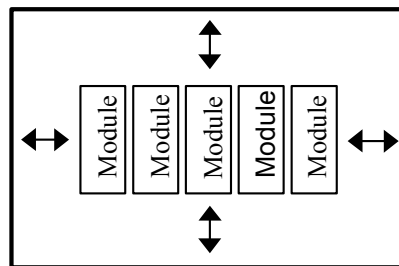

Allow a minimum of 50mm (2 in) of ventilation space on the top and bottom of each module and to each side of a grouping of modules